


## EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:229.7V I:0.8725A P:197.0W PF:0.9830 Freq:50.00Hz UTHDi:0% ITHDi:0% Lamp Flux:26695.2x1 lm		
NAME: HB38-200-5080-H08401	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 135.49 lm/W			
MODEL	/	I <sub>max</sub> (cd)	31298	S/MH (C0/180)	1.18
NOMINAL POWER(W)	200	LOR(%)	100.0	S/MH (C90/270)	0.49
RATED VOLTAGE(V)	230	TOTAL FLUX(lm)	26695	η UP,DN(C0-180)	0.0,50.0
NOMINAL FLUX(lm)	26695.2	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.0
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE(V)	230	η down (%)	100.0	CIBSE SHR MAX	0.55

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

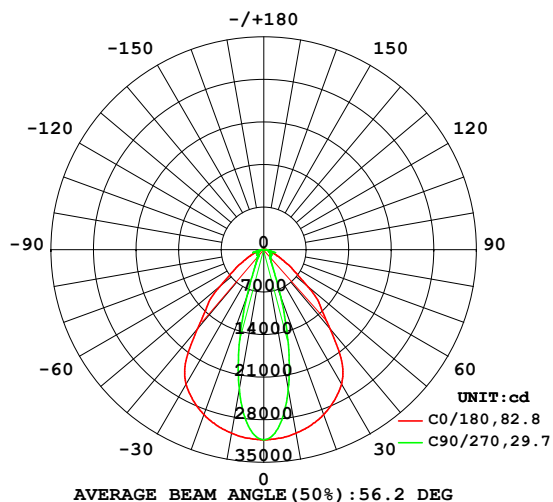

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

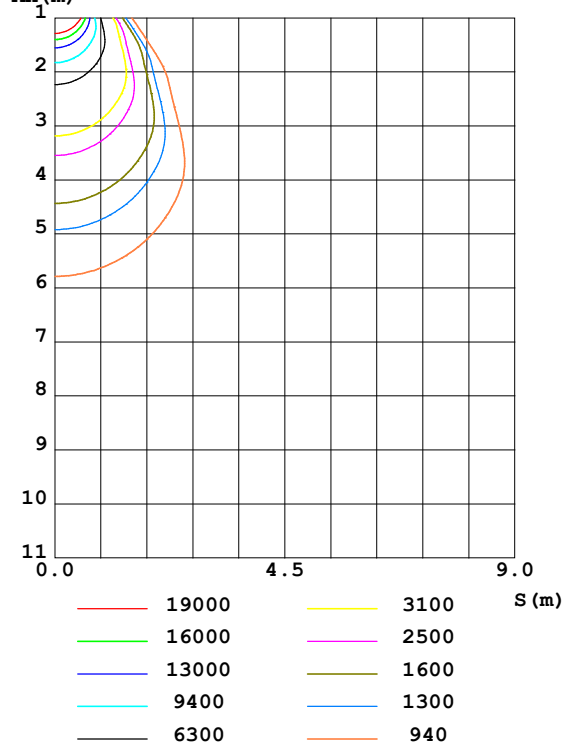

C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: LI  
Test Date: 2020-06-12

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System: EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity: 65.0%  
Test Distance: 26.000m [K=0.4589]  
Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum,lamp
10	3067	2674	2333	2674	3067	2674	2333	2674	0- 10	2770	2770	10.4,10.4
20	2886	1553	819.1	1553	2886	1553	819.1	1553	10- 20	6102	8872	33.2,33.2
30	2560	576.9	261.0	576.9	2560	576.9	261.0	576.9	20- 30	5906	14778	55.4,55.4
40	1699	227.3	163.1	227.3	1699	227.3	163.1	227.3	30- 40	4620	19398	72.7,72.7
50	951.2	143.4	140.4	143.4	951.2	143.4	140.4	143.4	40- 50	2988	22386	83.9,83.9
60	400.6	112.1	120.4	112.1	400.6	112.1	120.4	112.1	50- 60	1923	24309	91.1,91.1
70	157.0	78.57	89.47	78.57	157.0	78.57	89.47	78.57	60- 70	1212	25521	95.6,95.6
80	48.95	51.62	77.84	51.62	48.95	51.62	77.84	51.62	70- 80	861.6	26383	98.8,98.8
90	0.6215	0.8510	2.760	0.8510	0.6215	0.8510	2.760	0.8510	80- 90	312.6	26695	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:×10cd									UNIT:lm		

Conical surface Flux(90deg): 21041 lm

%lum = 78.8%

%lamp = 78.8%

Conical surface Flux(120deg): 24309 lm

%lum = 91.1%


%lamp = 91.1%

C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:LI  
Test Date:2020-06-12

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity:65.0%  
Test Distance:26.000m [K=0.4589]  
Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## LUMINANCE LIMITATION CURVES

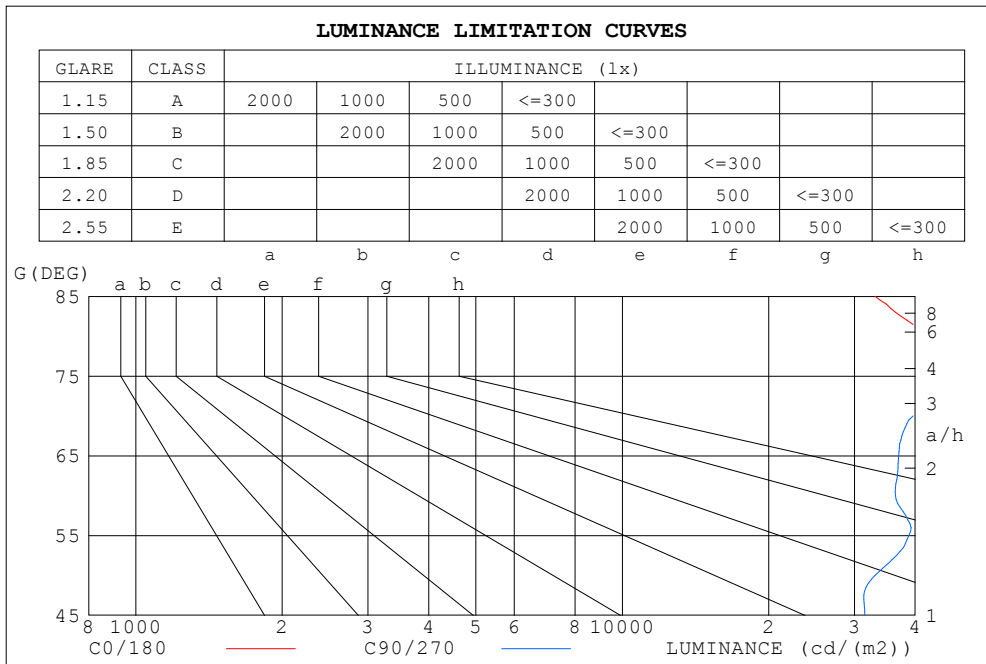

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	33069	75593
80	42958	67862
75	54230	104533
70	69965	39602
65	90968	36996
60	122087	36439
55	163358	38819
50	225488	33068
45	284919	31495


C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:LI  
Test Date:2020-06-12

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity:65.0%  
Test Distance:26.000m [K=0.4589]  
Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

pcc	80%			70%			50%			30%			10%			0
p <sub>w</sub>	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
p <sub>fc</sub>	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.08	1.05	1.02	1.06	1.03	1.00	1.02	.99	.97	.98	.96	.94	.94	.93	.91	.89
2.0	.98	.93	.89	.96	.92	.88	.93	.89	.86	.90	.87	.84	.87	.84	.82	.80
3.0	.90	.84	.79	.88	.83	.78	.86	.81	.77	.83	.79	.76	.81	.77	.74	.73
4.0	.83	.76	.71	.81	.75	.70	.79	.74	.69	.77	.72	.69	.75	.71	.68	.66
5.0	.76	.69	.64	.75	.69	.64	.74	.68	.63	.72	.67	.63	.70	.66	.62	.61
6.0	.71	.64	.59	.70	.64	.59	.69	.63	.58	.67	.62	.58	.66	.61	.57	.56
7.0	.66	.59	.54	.66	.59	.54	.64	.58	.54	.63	.58	.54	.62	.57	.53	.52
8.0	.62	.55	.51	.62	.55	.50	.60	.54	.50	.59	.54	.50	.58	.53	.50	.48
9.0	.58	.52	.47	.58	.52	.47	.57	.51	.47	.56	.51	.47	.55	.50	.47	.45
10.0	.55	.49	.44	.55	.48	.44	.54	.48	.44	.53	.48	.44	.52	.47	.44	.42

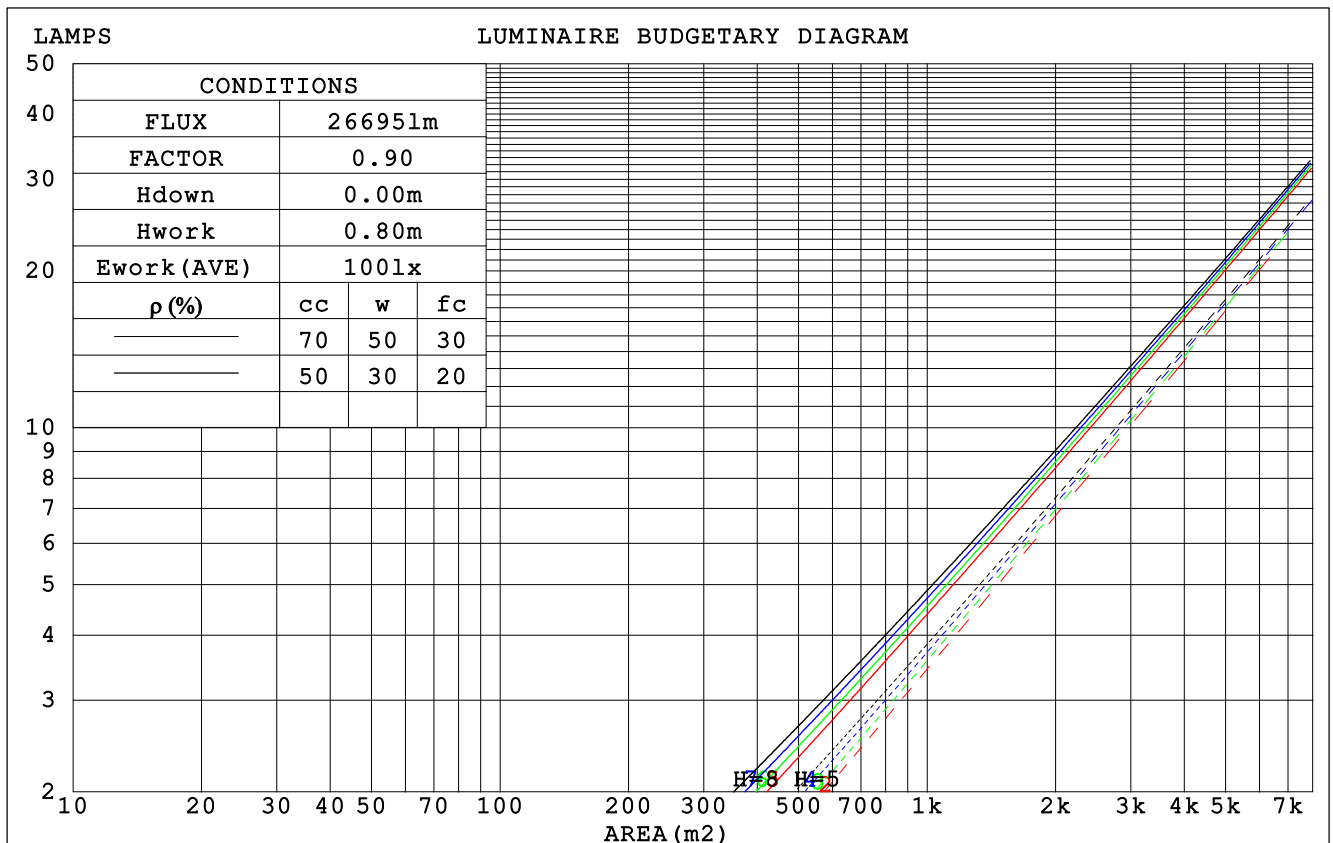

C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: LI  
Test Date: 2020-06-12

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System: EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity: 65.0%  
Test Distance: 26.000m [K=0.4589]  
Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## WEC AND CCEC

$\rho_{cc}$	80%			70%			50%			30%			10%			0														
$\rho_w$	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
$\rho_{fc}$	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.232	.132	.042	.225	.128	.041	.212	.122	.039	.200	.115	.037	.189	.110	.035															
2.0	.217	.119	.037	.212	.117	.036	.200	.111	.035	.190	.107	.033	.181	.102	.032															
3.0	.203	.108	.032	.198	.106	.032	.188	.102	.031	.179	.098	.030	.171	.095	.029															
4.0	.189	.098	.029	.185	.097	.029	.177	.094	.028	.169	.091	.027	.162	.088	.027															
5.0	.177	.090	.026	.174	.089	.026	.166	.087	.025	.159	.084	.025	.153	.082	.025															
6.0	.167	.084	.024	.163	.082	.024	.157	.080	.023	.151	.078	.023	.145	.076	.023															
7.0	.157	.078	.022	.154	.077	.022	.148	.075	.022	.143	.073	.021	.138	.072	.021															
8.0	.148	.072	.020	.146	.072	.020	.141	.070	.020	.136	.069	.020	.131	.067	.020															
9.0	.140	.068	.019	.138	.067	.019	.133	.066	.019	.129	.065	.019	.125	.064	.018															
10.0	.133	.064	.018	.131	.063	.018	.127	.062	.018	.123	.061	.017	.120	.060	.017															

$\rho_{cc}$	80%			70%			50%			30%			10%			0
$\rho_w$	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
$\rho_{fc}$	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.175	.157	.141	.150	.135	.121	.102	.093	.084	.059	.054	.049	.019	.017	.016	
2.0	.162	.132	.107	.139	.114	.093	.095	.079	.065	.055	.046	.038	.018	.015	.012	
3.0	.152	.114	.084	.130	.098	.073	.089	.068	.051	.052	.040	.030	.017	.013	.010	
4.0	.142	.100	.067	.122	.086	.058	.084	.060	.041	.049	.035	.024	.016	.011	.008	
5.0	.134	.088	.055	.115	.077	.048	.079	.053	.034	.046	.031	.020	.015	.010	.007	
6.0	.126	.080	.046	.109	.069	.040	.075	.048	.028	.043	.028	.017	.014	.009	.006	
7.0	.120	.072	.039	.103	.063	.034	.071	.044	.024	.041	.026	.014	.013	.008	.005	
8.0	.114	.066	.033	.098	.057	.029	.068	.040	.021	.039	.024	.012	.013	.008	.004	
9.0	.108	.061	.029	.093	.053	.025	.064	.037	.018	.038	.022	.011	.012	.007	.004	
10.0	.103	.057	.026	.089	.049	.022	.062	.035	.016	.036	.020	.010	.012	.007	.003	

C Range: 0 - 360DEG  
 C Interval: 10.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:LI  
 Test Date:2020-06-12

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
 Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
 Humidity:65.0%  
 Test Distance:26.000m [K=0.4589]  
 Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	24.6	25.9	25.0	26.2	26.5	21.2	22.5	21.6	22.8	23.2
3H	26.2	27.4	26.6	27.7	28.1	23.2	24.4	23.6	24.7	25.1
4H	26.8	27.8	27.2	28.2	28.6	26.9	27.9	27.3	28.3	28.7
6H	27.1	28.1	27.5	28.5	28.9	28.1	29.1	28.5	29.4	29.8
8H	27.2	28.2	27.7	28.6	29.0	28.4	29.3	28.8	29.7	30.1
12H	27.3	28.2	27.7	28.6	29.0	28.7	29.5	29.1	29.9	30.4
4H 2H	24.7	25.7	25.1	26.1	26.5	21.8	22.8	22.2	23.2	23.6
3H	26.4	27.3	26.8	27.7	28.1	24.0	24.9	24.4	25.3	25.7
4H	27.0	27.8	27.4	28.2	28.7	27.7	28.5	28.1	28.9	29.4
6H	27.5	28.2	27.9	28.6	29.1	29.2	29.9	29.7	30.4	30.8
8H	27.6	28.3	28.1	28.7	29.2	29.6	30.2	30.0	30.7	31.1
12H	27.7	28.3	28.2	28.8	29.2	29.9	30.5	30.4	30.9	31.4
8H 4H	27.2	27.8	27.6	28.2	28.7	27.8	28.4	28.3	28.9	29.4
6H	27.7	28.2	28.2	28.7	29.2	29.6	30.1	30.1	30.6	31.1
8H	27.9	28.4	28.4	28.9	29.4	30.1	30.6	30.6	31.1	31.6
12H	28.0	28.4	28.6	28.9	29.5	30.6	31.0	31.1	31.5	32.0
12H 4H	27.3	27.8	27.8	28.3	28.8	27.8	28.4	28.3	28.8	29.3
6H	27.9	28.3	28.4	28.8	29.3	29.6	30.1	30.2	30.6	31.1
8H	28.1	28.5	28.6	29.0	29.6	30.2	30.6	30.7	31.1	31.7
CIE190: 2010										

CIE190: 2010  
Area: 0.066 m2

C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:LI  
Test Date:2020-06-12

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity:65.0%  
Test Distance:26.000m [K=0.4589]  
Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## UTILIZATION FACTORS TABLE


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	75	66	61	74	66	61	73	65	61	56
0.80	83	75	70	82	75	70	81	74	69	64
1.00	89	82	76	89	81	76	87	82	76	70
1.25	95	87	82	94	87	82	91	85	81	76
1.50	98	92	87	97	91	86	94	89	85	79
2.00	103	97	92	101	96	92	98	94	90	84
2.50	105	100	96	104	99	95	100	96	93	86
3.00	108	103	99	106	101	98	102	99	96	88
4.00	110	106	103	108	105	102	104	102	99	91
5.00	112	109	106	110	107	104	106	103	101	93
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
 C Interval: 10.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: LI  
 Test Date: 2020-06-12

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
 Test System: EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
 Humidity: 65.0%  
 Test Distance: 26.000m [K=0.4589]  
 Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

## ISOCANDELA DIAGRAM

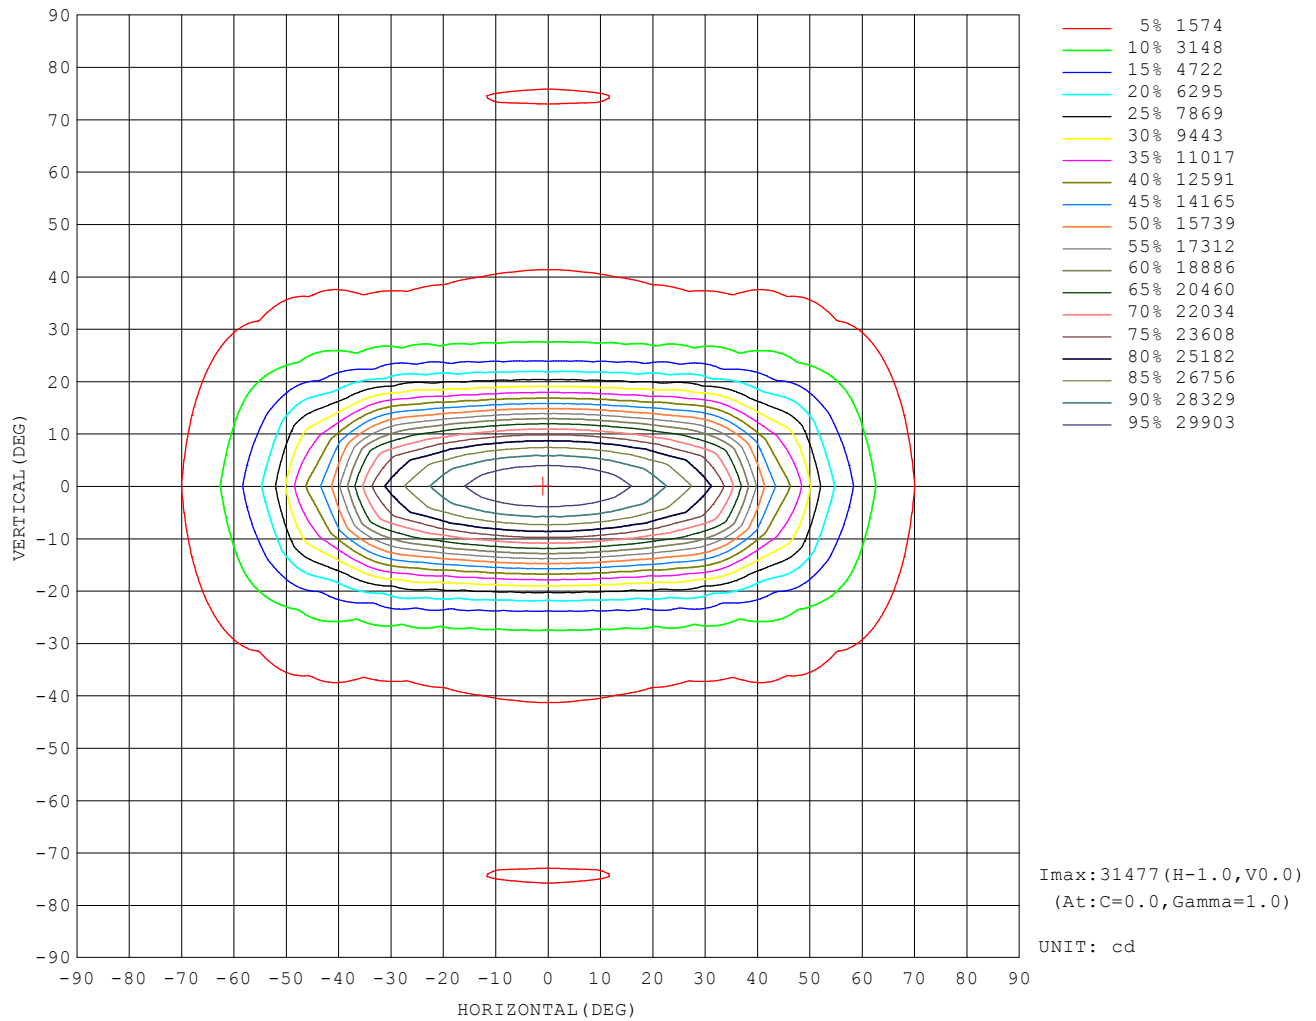


C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:LI  
Test Date:2020-06-12

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity:65.0%  
Test Distance:26.000m [K=0.4589]  
Remarks:



## AAI Figure

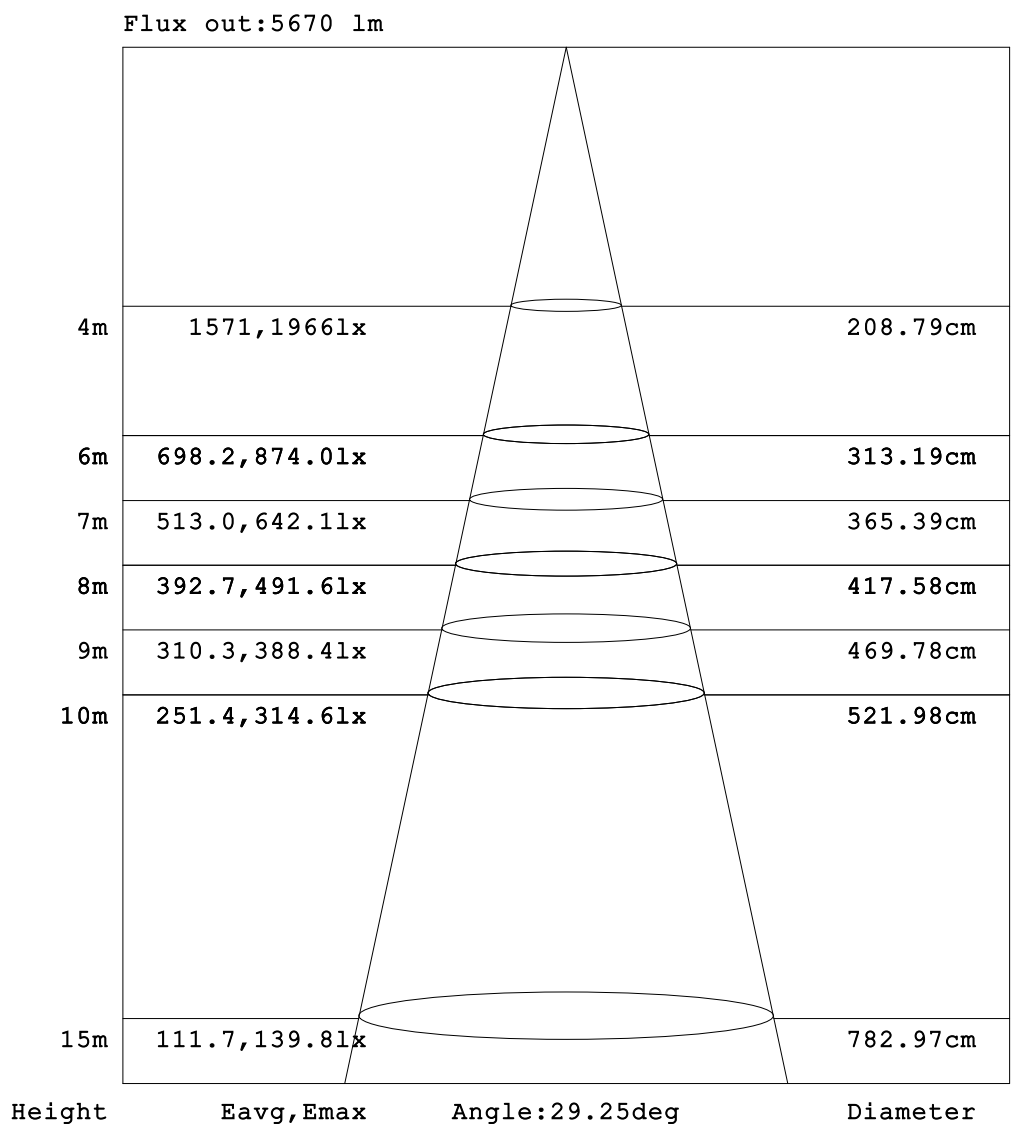


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:LI  
Test Date:2020-06-12

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity:65.0%  
Test Distance:26.000m [K=0.4589]  
Remarks:

# EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


## ISOLUX DIAGRAM

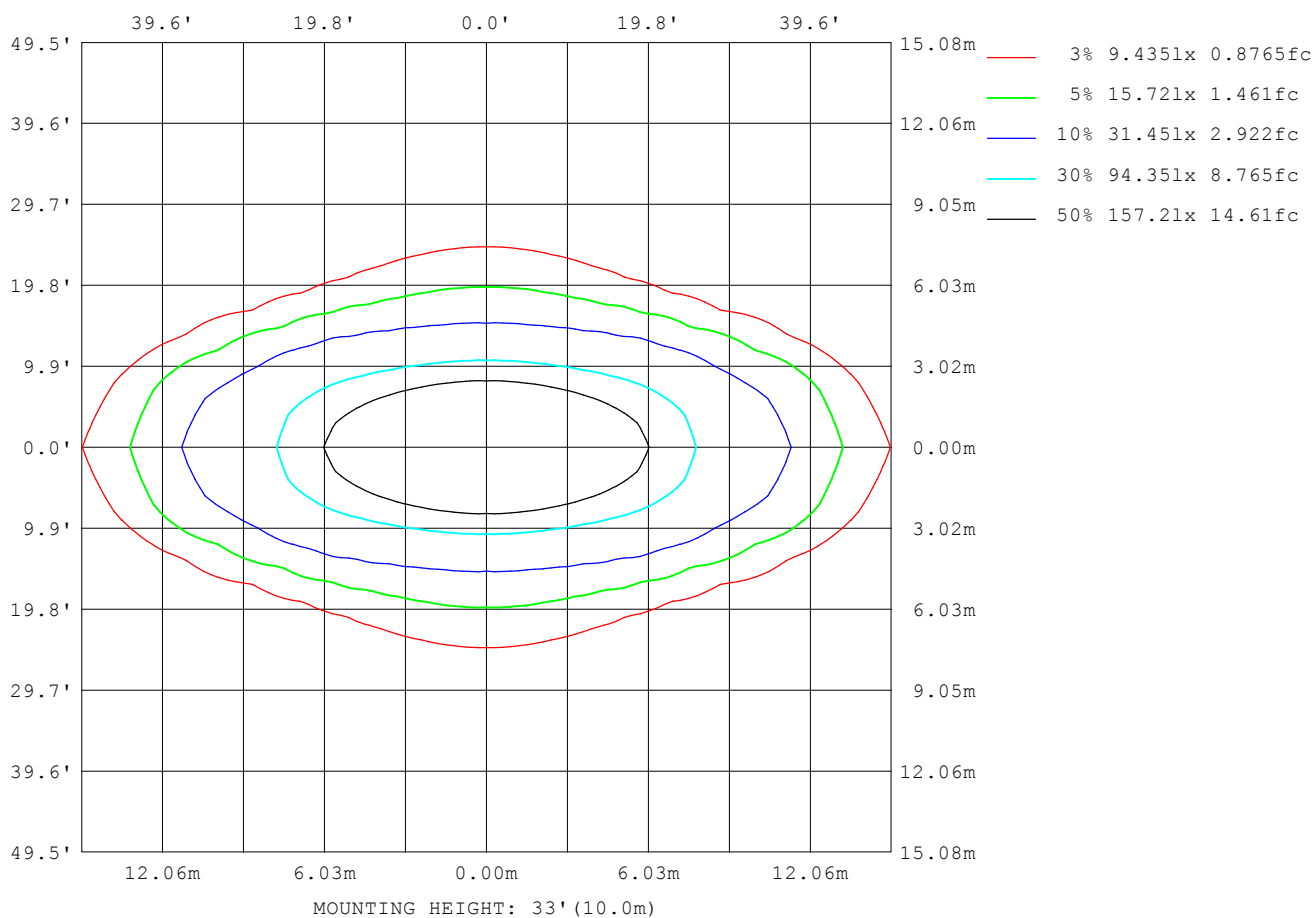

C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: LI  
Test Date: 2020-06-12

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
Test System: EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity: 65.0%  
Test Distance: 26.000m [K=0.4589]  
Remarks:

## Planar Illuminance Curve

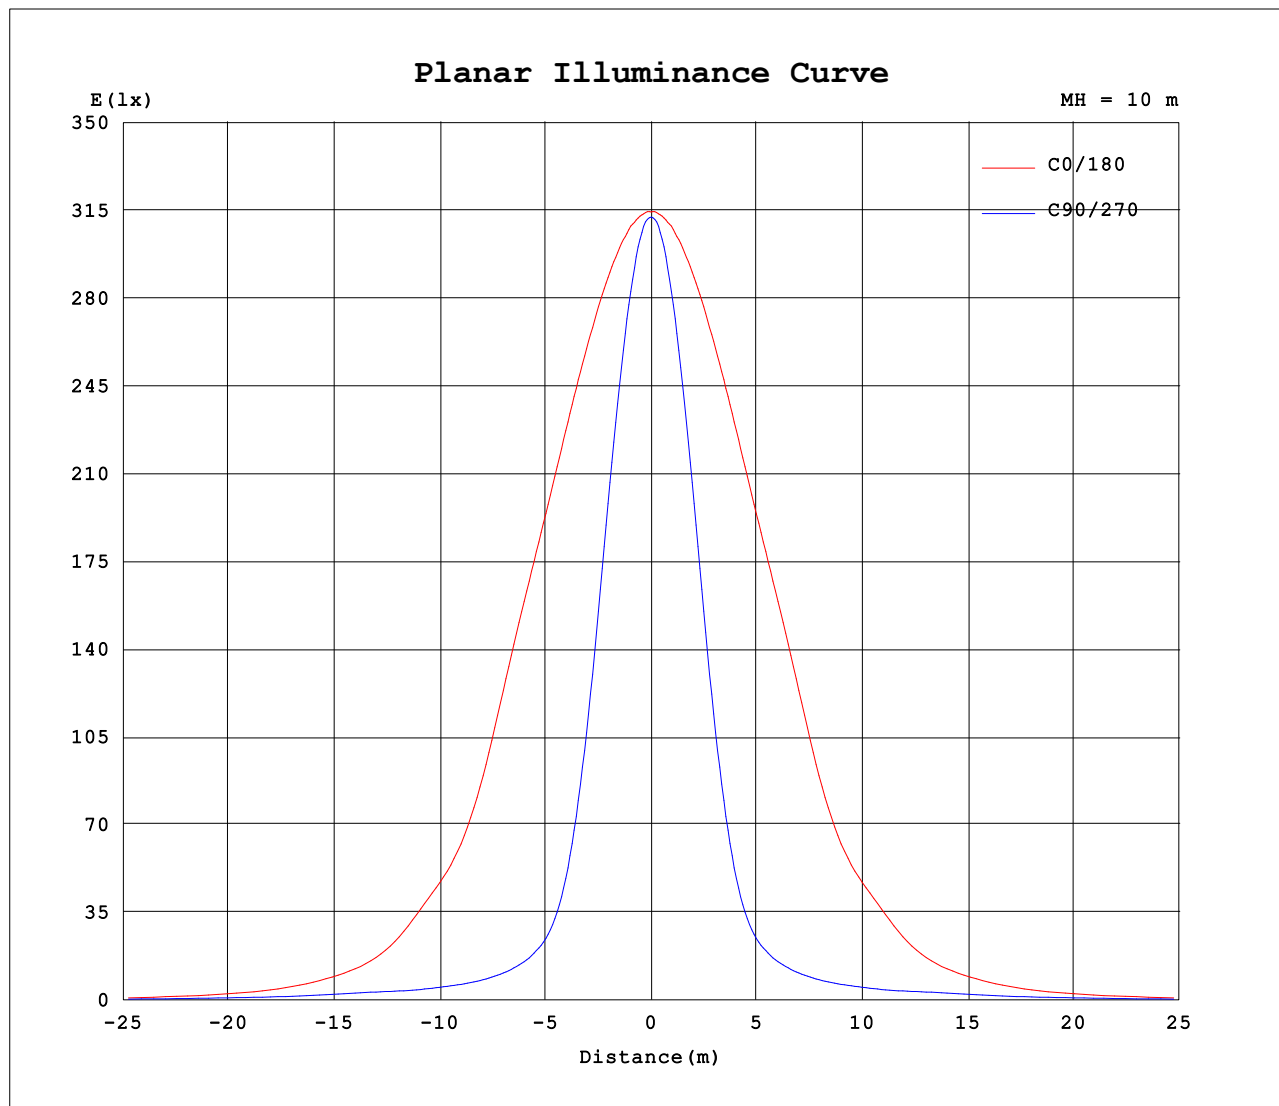

C Range: 0 - 360DEG  
C Interval: 10.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: LI  
Test Date: 2020-06-12

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
Test System: EVERFINE GO-R5000\_V2 SYSTEM V2.00.426  
Humidity: 65.0%  
Test Distance: 26.000m [K=0.4589]  
Remarks: