


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINAIRE PHOTOMETRIC TEST REPORT


| | | |
|---|-------|------------------|
| Test:U:230.00V I:2.0946A P:479.30W PF:0.9949 Freq:50.00Hz UTHDi:0% ITHDi:0% Lamp Flux:74047.1lx1 lm | | |
| NAME: LHB09-480-5070-L03901 | TYPE: | WEIGHT: |
| SPEC.: | DIM.: | SERIAL No.: |
| MFR.: | SUR.: | Shielding Angle: |

| DATA OF LAMP | | PHOTOMETRIC DATA Eff: 154.49 lm/W | | | |
|------------------|---------|-----------------------------------|--------|--------------------|----------|
| MODEL | / | I _{max} (cd) | 130602 | S/MH (C0/180) | 0.74 |
| NOMINAL POWER(W) | / | LOR(%) | 100.0 | S/MH (C90/270) | 0.74 |
| RATED VOLTAGE(V) | / | TOTAL FLUX (lm) | 74047 | η UP,DN (C0-180) | 0.0,50.5 |
| NOMINAL FLUX(lm) | 74047.1 | CIE CLASS | DIRECT | η UP,DN (C180-360) | 0.0,49.5 |
| LAMPS INSIDE | 1 | η up (%) | 0.0 | CIBSE SHR NOM | 0.75 |
| TEST VOLTAGE (V) | 230 | η down (%) | 100.0 | CIBSE SHR MAX | 0.75 |

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

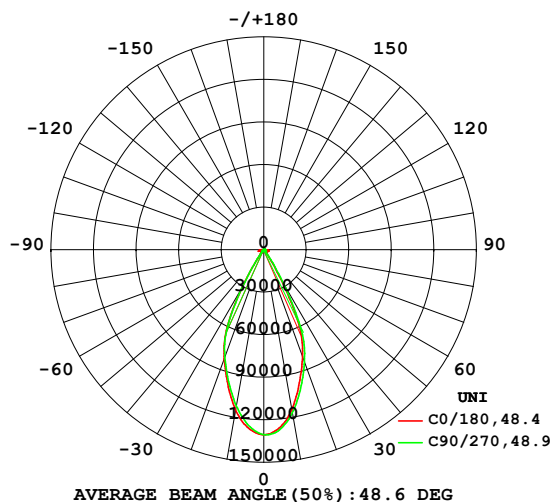

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

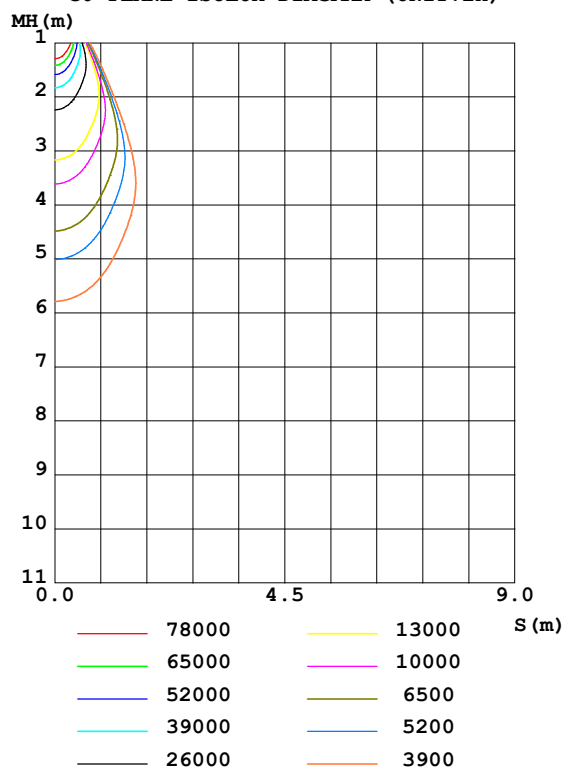

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:LYJ
Test Date:2021-03-01

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.426
Humidity:65.0%
Test Distance:26.000m [K=0.4574]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

| γ | C0 | C45 | C90 | C135 | C180 | C225 | C270 | C315 | γ | Φ zone | Φ total | %lum, lamp |
|----------|---------------------------|--------|--------|--------|--------|--------|--------|--------|----------|-------------|--------------|------------|
| 10 | 1144 | 1169 | 1168 | 1173 | 1148 | 1129 | 1118 | 1133 | 0- 10 | 11680 | 11680 | 15.8,15.8 |
| 20 | 802.2 | 759.7 | 840.4 | 773.8 | 818.6 | 738.5 | 805.6 | 726.2 | 10- 20 | 27075 | 38755 | 52.3,52.3 |
| 30 | 244.7 | 270.0 | 286.2 | 293.9 | 290.8 | 288.2 | 291.7 | 264.0 | 20- 30 | 24458 | 63212 | 85.4,85.4 |
| 40 | 28.38 | 27.65 | 23.62 | 29.35 | 29.66 | 31.76 | 23.45 | 25.30 | 30- 40 | 6313 | 69525 | 93.9,93.9 |
| 50 | 19.15 | 12.02 | 12.85 | 12.00 | 19.65 | 11.96 | 12.53 | 11.11 | 40- 50 | 1200 | 70725 | 95.5,95.5 |
| 60 | 14.26 | 9.461 | 9.843 | 9.745 | 14.99 | 9.692 | 9.910 | 9.087 | 50- 60 | 918.9 | 71644 | 96.8,96.8 |
| 70 | 11.39 | 6.886 | 6.096 | 6.901 | 9.191 | 6.768 | 6.128 | 6.795 | 60- 70 | 750.7 | 72395 | 97.8,97.8 |
| 80 | 23.88 | 7.369 | 7.269 | 7.617 | 26.70 | 6.851 | 6.701 | 7.201 | 70- 80 | 960.9 | 73356 | 99.1,99.1 |
| 90 | 0.0374 | 0.0187 | 0.0209 | 0.1708 | 0.1866 | 0.8990 | 0.1144 | 0.0264 | 80- 90 | 691.4 | 74047 | 100,100 |
| 100 | | | | | | | | | 90-100 | | | |
| 110 | | | | | | | | | 100-110 | | | |
| 120 | | | | | | | | | 110-120 | | | |
| 130 | | | | | | | | | 120-130 | | | |
| 140 | | | | | | | | | 130-140 | | | |
| 150 | | | | | | | | | 140-150 | | | |
| 160 | | | | | | | | | 150-160 | | | |
| 170 | | | | | | | | | 160-170 | | | |
| 180 | | | | | | | | | 170-180 | | | |
| DEG | LUMINOUS INTENSITY:×100cd | | | | | | | | | UNIT:lm | | |

Conical surface Flux(90deg): 70204 lm

%lum = 94.8%

%lamp = 94.8%

Conical surface Flux(120deg): 71644 lm

%lum = 96.8%


%lamp = 96.8%

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:LYJ
Test Date:2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.426
Humidity:65.0%
Test Distance:26.000m [K=0.4574]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINANCE LIMITATION CURVES

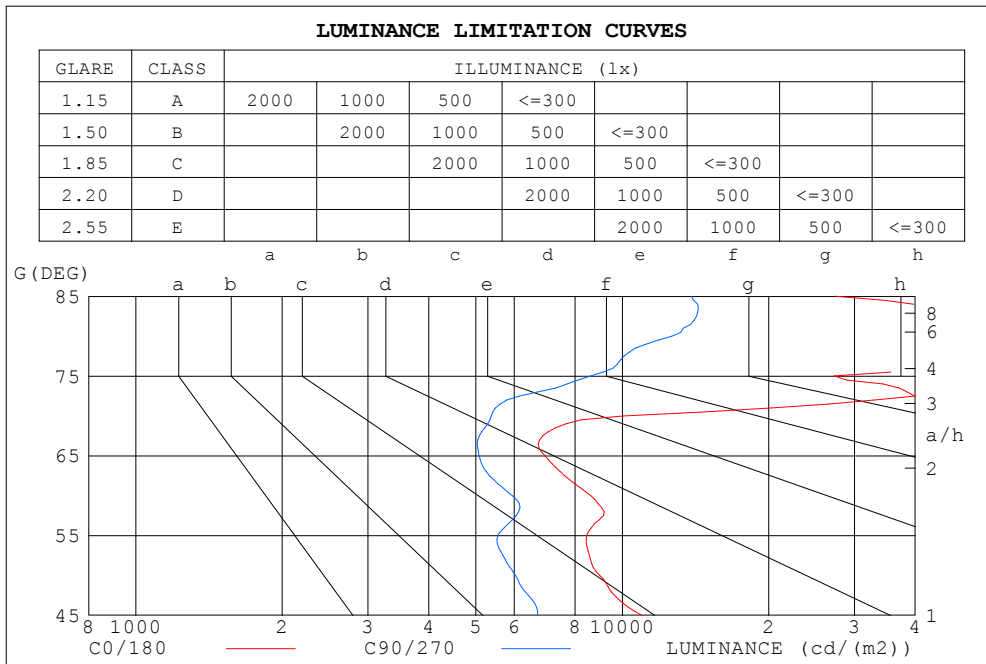

| LUMINANCE cd/(m2) | | |
|-------------------|--------|---------|
| G (DEG) | C0/180 | C90/270 |
| 85 | 27461 | 13852 |
| 80 | 41515 | 12630 |
| 75 | 27230 | 8607 |
| 70 | 10056 | 5378 |
| 65 | 6933 | 5077 |
| 60 | 8611 | 5940 |
| 55 | 8450 | 5549 |
| 50 | 8990 | 6033 |
| 45 | 10957 | 6699 |


C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: LYJ
 Test Date: 2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.426
 Humidity: 65.0%
 Test Distance: 26.000m [K=0.4574]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

| pcc | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 |
|-----------------|-----------------------|------|------|---------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|
| p _w | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 |
| p _{fc} | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 |
| RCR | RCR:Room Cavity Ratio | | | Coefficients of Utilization(CU) | | | | | | | | | | | | |
| 0.0 | 1.19 | 1.19 | 1.19 | 1.16 | 1.16 | 1.16 | 1.11 | 1.11 | 1.11 | 1.06 | 1.06 | 1.06 | 1.02 | 1.02 | 1.02 | 1.00 |
| 1.0 | 1.11 | 1.08 | 1.06 | 1.08 | 1.06 | 1.04 | 1.04 | 1.03 | 1.01 | 1.01 | .99 | .98 | .97 | .96 | .95 | .93 |
| 2.0 | 1.04 | .00 | .96 | 1.02 | .98 | .95 | .99 | .96 | .93 | .96 | .93 | .91 | .93 | .91 | .89 | .88 |
| 3.0 | .97 | .93 | .89 | .96 | .92 | .88 | .93 | .90 | .87 | .91 | .88 | .86 | .89 | .86 | .84 | .83 |
| 4.0 | .92 | .87 | .83 | .91 | .86 | .82 | .89 | .85 | .81 | .87 | .83 | .81 | .85 | .82 | .80 | .78 |
| 5.0 | .87 | .82 | .78 | .86 | .81 | .77 | .84 | .80 | .77 | .83 | .79 | .76 | .81 | .78 | .75 | .74 |
| 6.0 | .83 | .77 | .73 | .82 | .77 | .73 | .80 | .76 | .73 | .79 | .75 | .72 | .78 | .74 | .72 | .70 |
| 7.0 | .79 | .73 | .69 | .78 | .73 | .69 | .77 | .72 | .69 | .76 | .72 | .69 | .75 | .71 | .68 | .67 |
| 8.0 | .75 | .70 | .66 | .74 | .69 | .66 | .73 | .69 | .66 | .72 | .68 | .65 | .72 | .68 | .65 | .64 |
| 9.0 | .72 | .66 | .63 | .71 | .66 | .63 | .70 | .66 | .62 | .69 | .65 | .62 | .69 | .65 | .62 | .61 |
| 10.0 | .69 | .63 | .60 | .68 | .63 | .60 | .67 | .63 | .60 | .67 | .62 | .59 | .66 | .62 | .59 | .58 |

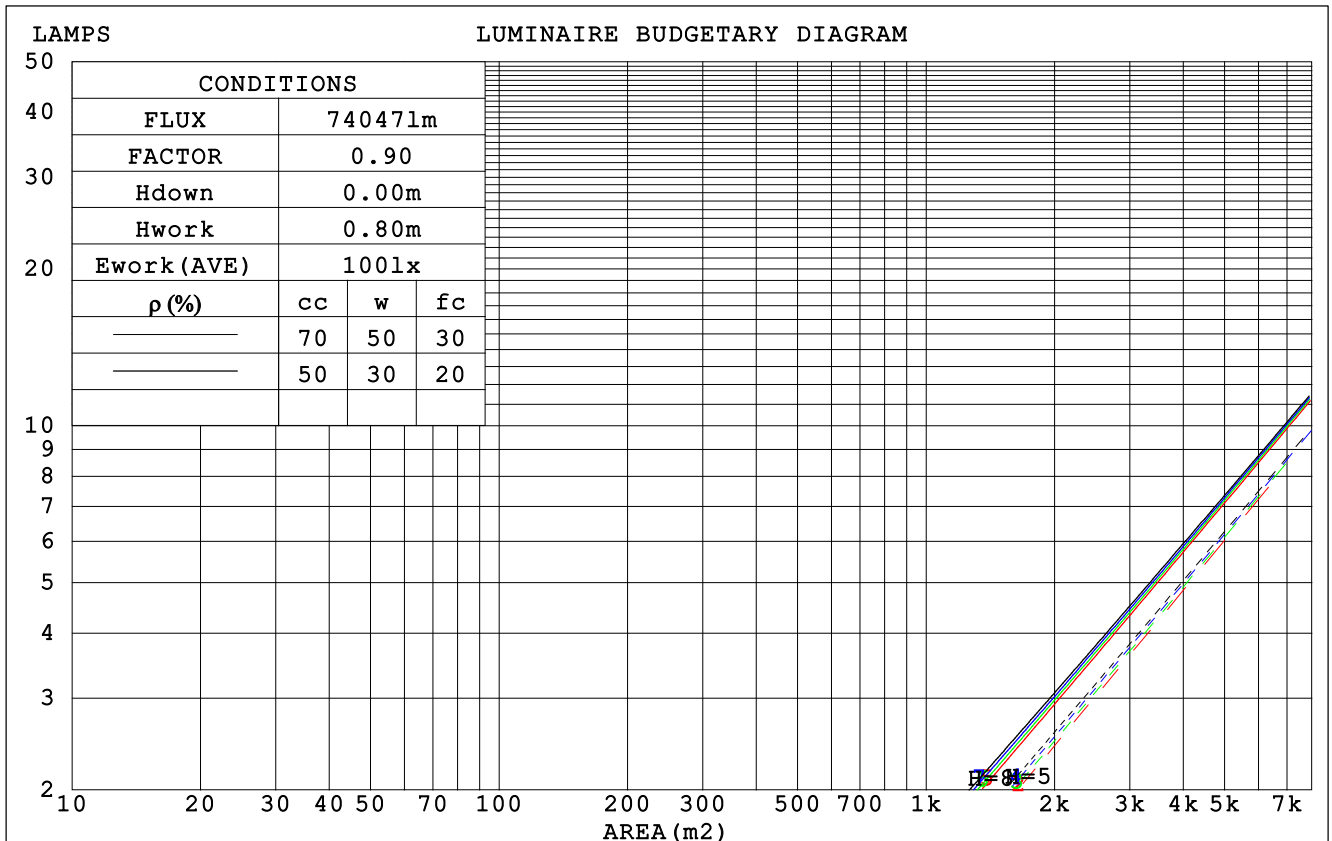

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:LYJ
 Test Date:2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.426
 Humidity:65.0%
 Test Distance:26.000m [K=0.4574]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

| pcc | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 | | | | | | | | | | | | | | |
|------|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|---------------------------------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| pw | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 | | | | | | | | | | | | | | |
| pfc | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 | | | | | | | | | | | | | | |
| RCR | RCR:Room Cavity Ratio | | | | | | | | | | | | | | | Wall Exitance Coefficients(WEC) | | | | | | | | | | | | | | |
| 0.0 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1.0 | .180 | .102 | .032 | .173 | .099 | .031 | .161 | .092 | .029 | .149 | .086 | .028 | .138 | .080 | .026 | | | | | | | | | | | | | | | |
| 2.0 | .166 | .091 | .028 | .160 | .088 | .027 | .150 | .083 | .026 | .140 | .078 | .025 | .131 | .074 | .023 | | | | | | | | | | | | | | | |
| 3.0 | .154 | .082 | .025 | .150 | .080 | .024 | .141 | .076 | .023 | .132 | .072 | .022 | .125 | .069 | .021 | | | | | | | | | | | | | | | |
| 4.0 | .145 | .075 | .022 | .141 | .074 | .022 | .133 | .070 | .021 | .126 | .068 | .020 | .119 | .065 | .020 | | | | | | | | | | | | | | | |
| 5.0 | .136 | .069 | .020 | .133 | .068 | .020 | .126 | .066 | .019 | .120 | .063 | .019 | .114 | .061 | .018 | | | | | | | | | | | | | | | |
| 6.0 | .129 | .065 | .019 | .126 | .064 | .018 | .120 | .062 | .018 | .115 | .060 | .018 | .110 | .058 | .017 | | | | | | | | | | | | | | | |
| 7.0 | .123 | .061 | .017 | .120 | .060 | .017 | .115 | .058 | .017 | .110 | .057 | .016 | .106 | .055 | .016 | | | | | | | | | | | | | | | |
| 8.0 | .117 | .057 | .016 | .115 | .056 | .016 | .110 | .055 | .016 | .106 | .054 | .015 | .102 | .052 | .015 | | | | | | | | | | | | | | | |
| 9.0 | .112 | .054 | .015 | .110 | .054 | .015 | .106 | .052 | .015 | .102 | .051 | .015 | .098 | .050 | .014 | | | | | | | | | | | | | | | |
| 10.0 | .107 | .051 | .014 | .105 | .051 | .014 | .102 | .050 | .014 | .098 | .049 | .014 | .095 | .048 | .014 | | | | | | | | | | | | | | | |

| pcc | 80% | | | 70% | | | 50% | | | 30% | | | 10% | | | 0 | |
|------|-----------------------|------|------|------|------|------|--|------|------|------|------|------|------|------|------|---|--|
| pw | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 50% | 30% | 10% | 0 | |
| pfc | 20% | | | 20% | | | 20% | | | 20% | | | 20% | | | 0 | |
| RCR | RCR:Room Cavity Ratio | | | | | | Ceiling Cavity Exitance Coefficients(CCEC) | | | | | | | | | | |
| 0.0 | .190 | .190 | .190 | .163 | .163 | .163 | .111 | .111 | .111 | .064 | .064 | .064 | .020 | .020 | .020 | | |
| 1.0 | .171 | .157 | .145 | .147 | .135 | .124 | .100 | .093 | .086 | .058 | .054 | .050 | .018 | .017 | .016 | | |
| 2.0 | .155 | .133 | .113 | .133 | .114 | .098 | .091 | .079 | .068 | .053 | .046 | .040 | .017 | .015 | .013 | | |
| 3.0 | .142 | .114 | .091 | .122 | .098 | .079 | .084 | .068 | .055 | .048 | .040 | .032 | .016 | .013 | .011 | | |
| 4.0 | .131 | .099 | .074 | .112 | .085 | .064 | .077 | .059 | .045 | .045 | .035 | .027 | .014 | .011 | .009 | | |
| 5.0 | .122 | .087 | .061 | .104 | .075 | .053 | .072 | .052 | .038 | .042 | .031 | .022 | .013 | .010 | .007 | | |
| 6.0 | .114 | .077 | .051 | .098 | .067 | .045 | .067 | .047 | .032 | .039 | .028 | .019 | .013 | .009 | .006 | | |
| 7.0 | .107 | .070 | .044 | .092 | .060 | .038 | .063 | .042 | .027 | .037 | .025 | .016 | .012 | .008 | .005 | | |
| 8.0 | .101 | .063 | .037 | .087 | .055 | .033 | .060 | .038 | .023 | .035 | .023 | .014 | .011 | .007 | .005 | | |
| 9.0 | .095 | .058 | .033 | .082 | .050 | .028 | .057 | .035 | .020 | .033 | .021 | .012 | .011 | .007 | .004 | | |
| 10.0 | .091 | .053 | .029 | .078 | .046 | .025 | .054 | .033 | .018 | .032 | .019 | .011 | .010 | .006 | .003 | | |

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:LYJ
 Test Date:2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.426
 Humidity:65.0%
 Test Distance:26.000m [K=0.4574]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UGR(Unified Glare Rating) Table

| | | | | | | | | | | |
|-----------------|------------------|------|------|------|------|----------------|------|------|------|------|
| ceiling/cavity | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 |
| walls | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 |
| working plane | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Room dimensions | Viewed crosswise | | | | | Viewed endwise | | | | |
| x = 2H y = 2H | 9.8 | 10.8 | 10.2 | 11.1 | 11.4 | 8.5 | 9.5 | 8.9 | 9.8 | 10.1 |
| 3H | 12.4 | 13.3 | 12.8 | 13.6 | 14.0 | 10.9 | 11.7 | 11.2 | 12.1 | 12.4 |
| 4H | 16.5 | 17.3 | 16.9 | 17.6 | 18.0 | 12.7 | 13.5 | 13.1 | 13.8 | 14.2 |
| 6H | 21.4 | 22.1 | 21.8 | 22.5 | 22.9 | 15.2 | 15.9 | 15.6 | 16.3 | 16.7 |
| 8H | 22.8 | 23.5 | 23.3 | 23.9 | 24.3 | 16.2 | 16.9 | 16.7 | 17.3 | 17.7 |
| 12H | 23.6 | 24.3 | 24.0 | 24.6 | 25.1 | 16.9 | 17.6 | 17.4 | 18.0 | 18.4 |
| 4H 2H | 10.5 | 11.3 | 10.9 | 11.6 | 12.0 | 9.6 | 10.4 | 10.0 | 10.7 | 11.1 |
| 3H | 13.2 | 13.8 | 13.6 | 14.2 | 14.6 | 12.1 | 12.8 | 12.5 | 13.2 | 13.6 |
| 4H | 16.9 | 17.5 | 17.4 | 18.0 | 18.4 | 14.2 | 14.8 | 14.7 | 15.3 | 15.7 |
| 6H | 22.0 | 22.5 | 22.4 | 22.9 | 23.4 | 16.8 | 17.3 | 17.3 | 17.8 | 18.3 |
| 8H | 23.6 | 24.1 | 24.1 | 24.5 | 25.0 | 17.9 | 18.4 | 18.4 | 18.8 | 19.3 |
| 12H | 24.6 | 25.0 | 25.1 | 25.5 | 26.0 | 18.7 | 19.1 | 19.2 | 19.6 | 20.1 |
| 8H 4H | 17.4 | 17.9 | 17.9 | 18.3 | 18.8 | 15.3 | 15.8 | 15.8 | 16.2 | 16.7 |
| 6H | 22.2 | 22.6 | 22.7 | 23.1 | 23.6 | 18.0 | 18.4 | 18.5 | 18.9 | 19.4 |
| 8H | 24.0 | 24.3 | 24.5 | 24.8 | 25.3 | 19.2 | 19.6 | 19.8 | 20.1 | 20.6 |
| 12H | 25.3 | 25.6 | 25.9 | 26.1 | 26.7 | 20.3 | 20.6 | 20.8 | 21.1 | 21.7 |
| 12H 4H | 17.5 | 17.9 | 18.0 | 18.4 | 18.9 | 15.6 | 16.0 | 16.1 | 16.5 | 17.0 |
| 6H | 22.3 | 22.6 | 22.8 | 23.1 | 23.6 | 18.3 | 18.7 | 18.9 | 19.2 | 19.7 |
| 8H | 24.1 | 24.4 | 24.6 | 24.9 | 25.4 | 19.8 | 20.0 | 20.3 | 20.5 | 21.1 |
| CIE190: 2010 | | | | | | | | | | |
| | | | | | | | | | | |

CIE190: 2010
Area: 0.3315 m2

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:LYJ
Test Date:2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.426
Humidity:65.0%
Test Distance:26.000m [K=0.4574]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


UTILIZATION FACTORS TABLE

| REFLECTANCE | | | | | | | | | | |
|----------------------------------|--|-----|-----------|-----|-----|-----|-----|---------------|-----|--------|
| Ceiling | 0.8 | 0.8 | 0.8 | 0.7 | 0.7 | 0.7 | 0.5 | 0.5 | 0.5 | 0 |
| Walls | 0.7 | 0.5 | 0.3 | 0.7 | 0.5 | 0.3 | 0.7 | 0.5 | 0.3 | 0 |
| Working plane | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0 |
| ROOM INDEX | UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$ | | | | | | | | | |
| $k = 0.60$ | 88 | 82 | 78 | 87 | 82 | 78 | 87 | 81 | 78 | 74 |
| 0.80 | 95 | 89 | 86 | 94 | 89 | 85 | 93 | 88 | 85 | 81 |
| 1.00 | 99 | 93 | 90 | 98 | 93 | 90 | 97 | 93 | 89 | 85 |
| 1.25 | 103 | 98 | 94 | 102 | 97 | 94 | 100 | 96 | 93 | 89 |
| 1.50 | 105 | 101 | 97 | 104 | 100 | 97 | 102 | 98 | 96 | 91 |
| 2.00 | 108 | 104 | 100 | 107 | 103 | 100 | 104 | 101 | 98 | 93 |
| 2.50 | 110 | 106 | 103 | 108 | 104 | 102 | 105 | 102 | 100 | 94 |
| 3.00 | 111 | 108 | 105 | 109 | 106 | 104 | 106 | 104 | 102 | 95 |
| 4.00 | 113 | 110 | 108 | 111 | 109 | 107 | 108 | 106 | 104 | 97 |
| 5.00 | 115 | 112 | 110 | 113 | 110 | 109 | 109 | 107 | 106 | 98 |
| ROOM INDEX | UF (total) | | | | | | | | | Direct |
| According to DIN EN 13032-2 2004 | | | Suspended | | | | | SHRNOM = 1.25 | | |

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: LYJ
 Test Date: 2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.426
 Humidity: 65.0%
 Test Distance: 26.000m [K=0.4574]
 Remarks:


ISOCANDELA DIAGRAM

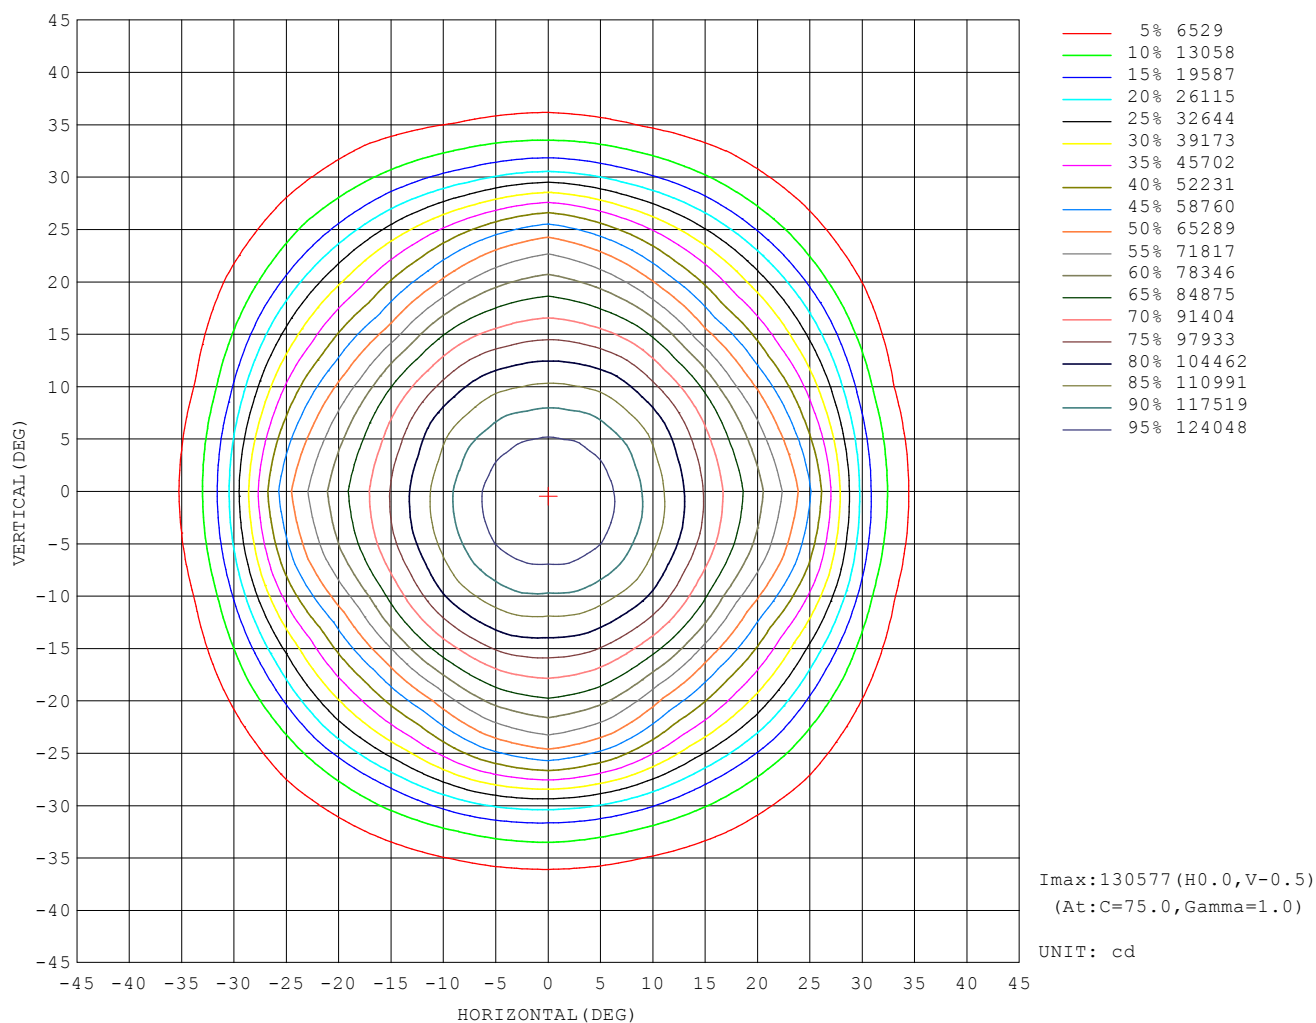

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:LYJ
Test Date:2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.426
Humidity:65.0%
Test Distance:26.000m [K=0.4574]
Remarks:

AAI Figure

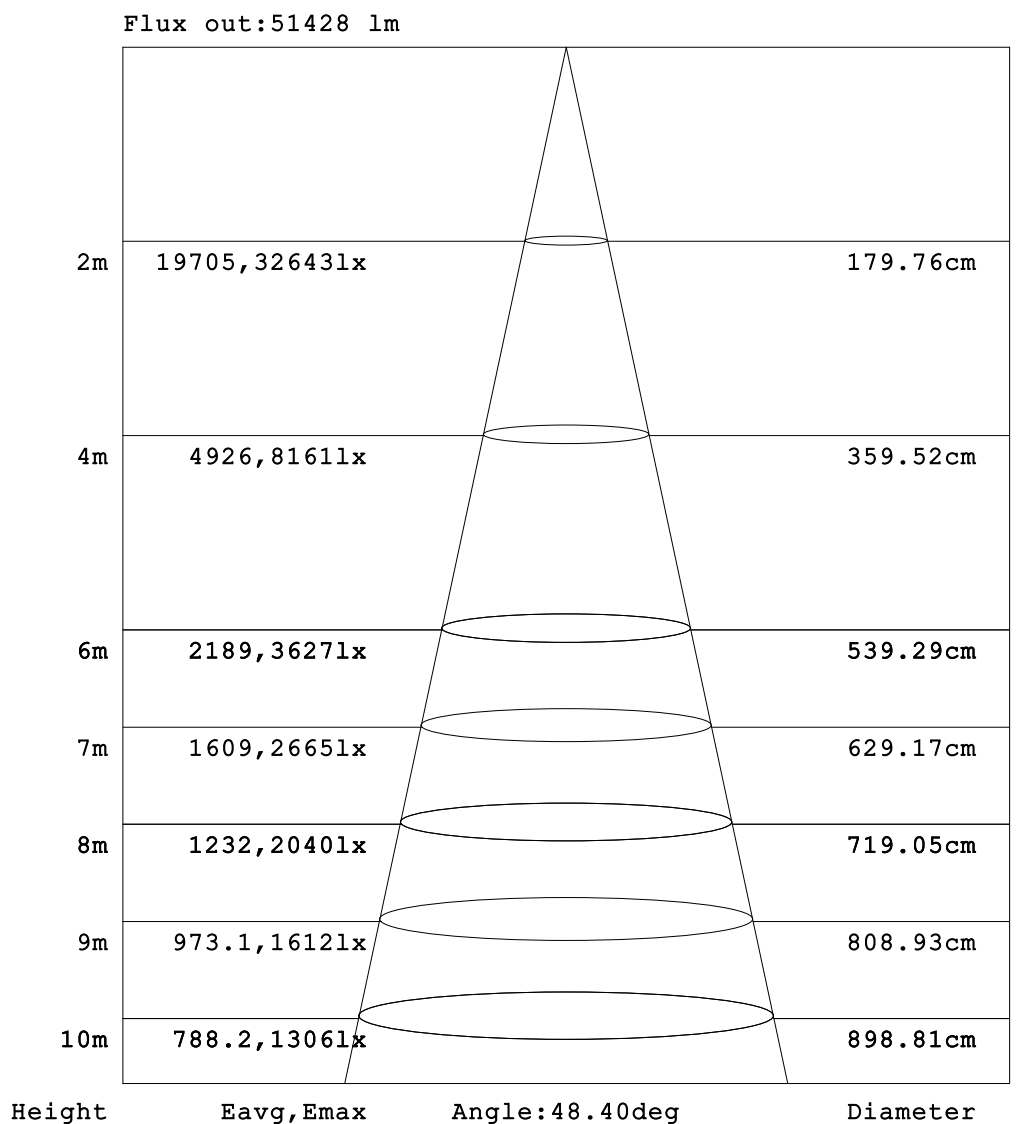


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:LYJ
Test Date:2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.426
Humidity:65.0%
Test Distance:26.000m [K=0.4574]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


ISOLUX DIAGRAM

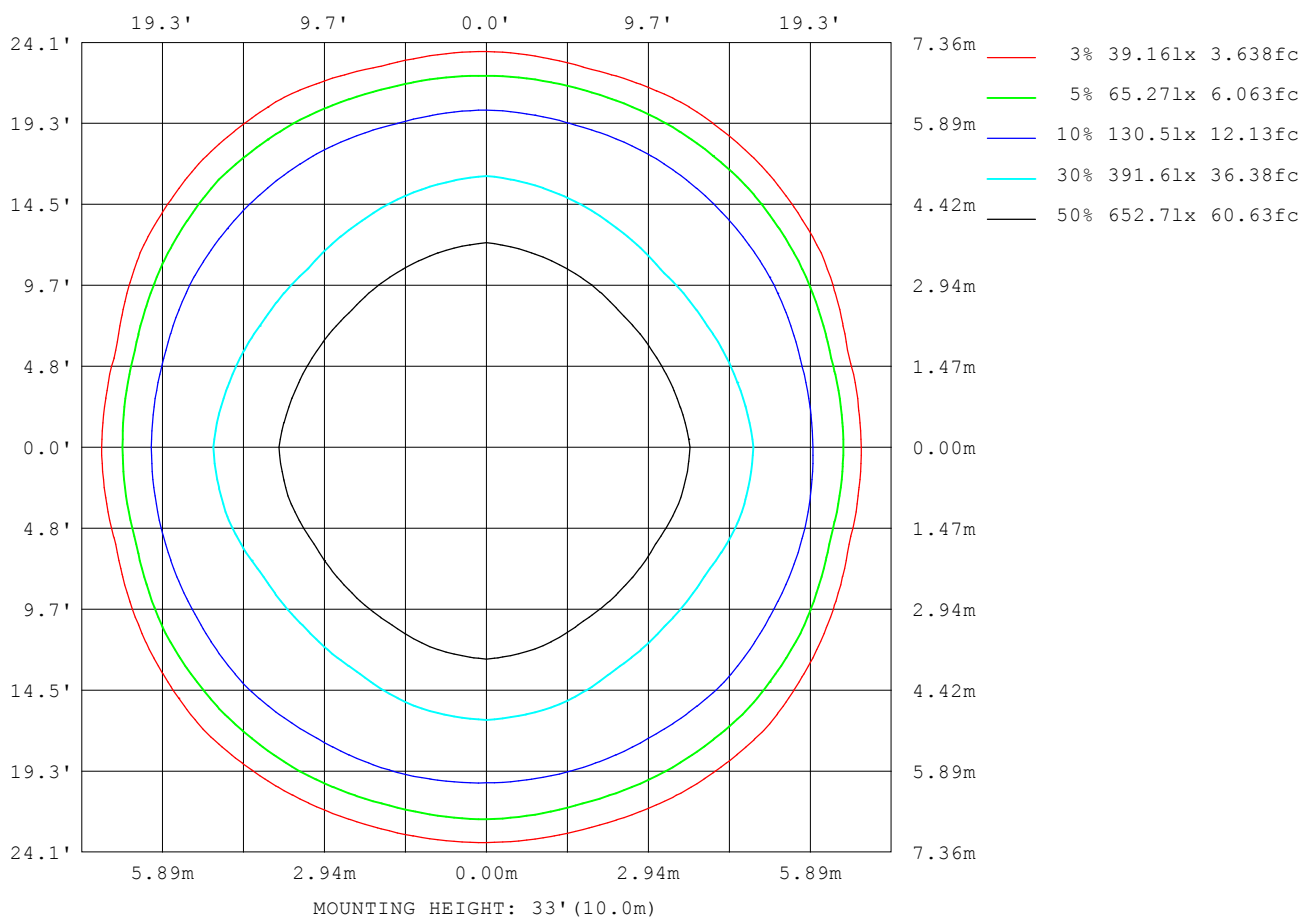

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: LYJ
Test Date: 2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.426
Humidity: 65.0%
Test Distance: 26.000m [K=0.4574]
Remarks:

Planar Illuminance Curve

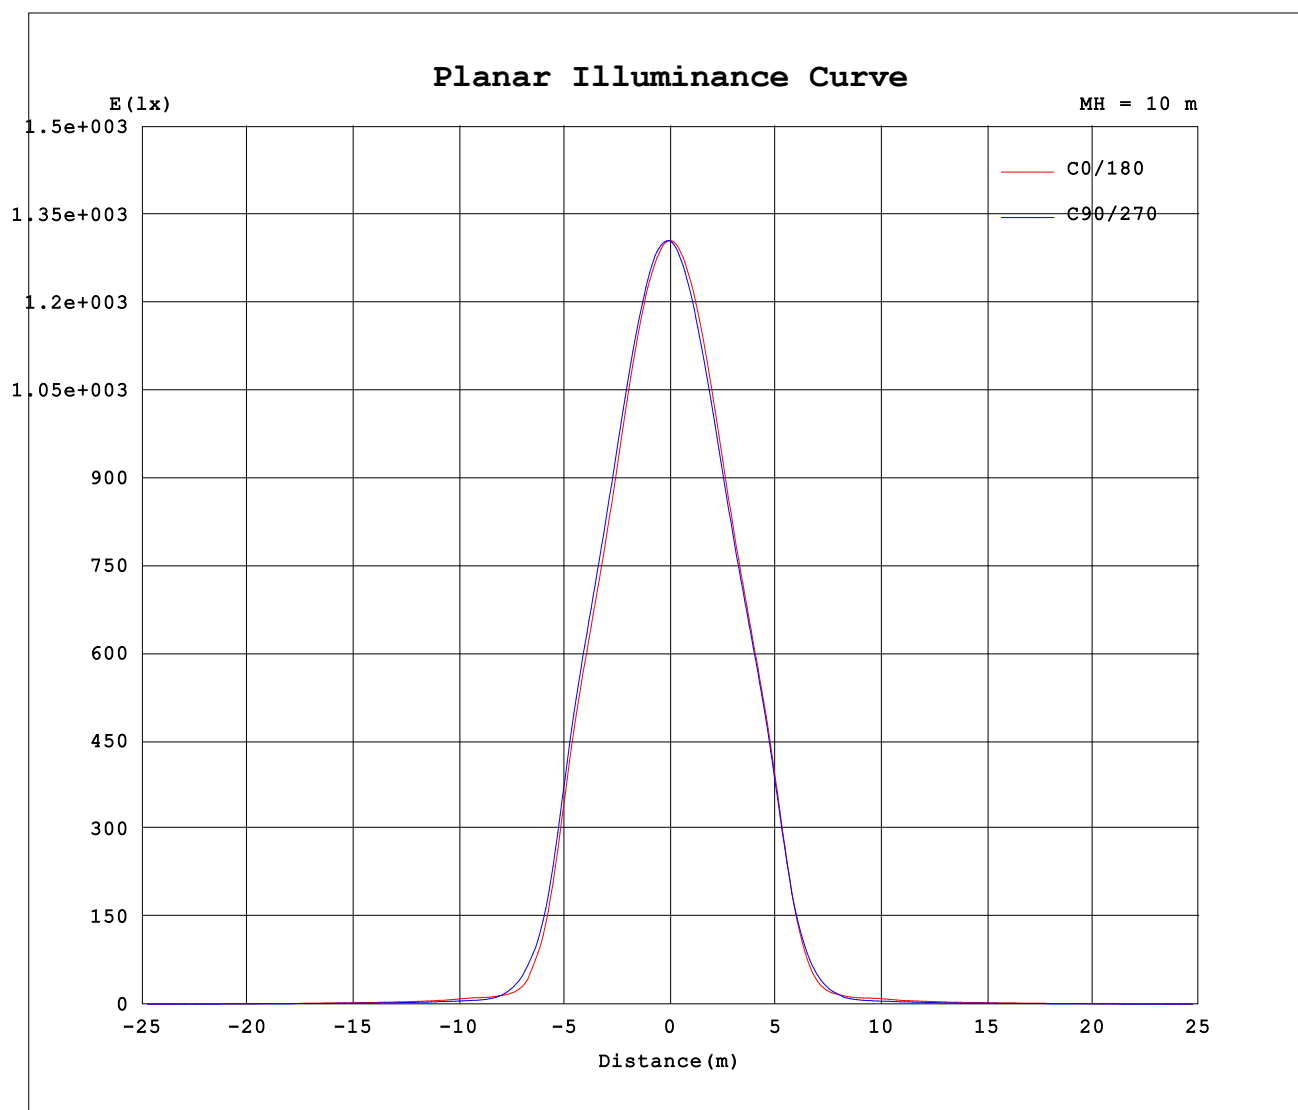

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: LYJ
Test Date: 2021-03-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.426
Humidity: 65.0%
Test Distance: 26.000m [K=0.4574]
Remarks: